


# Typical Category 2 Net Metering One-line

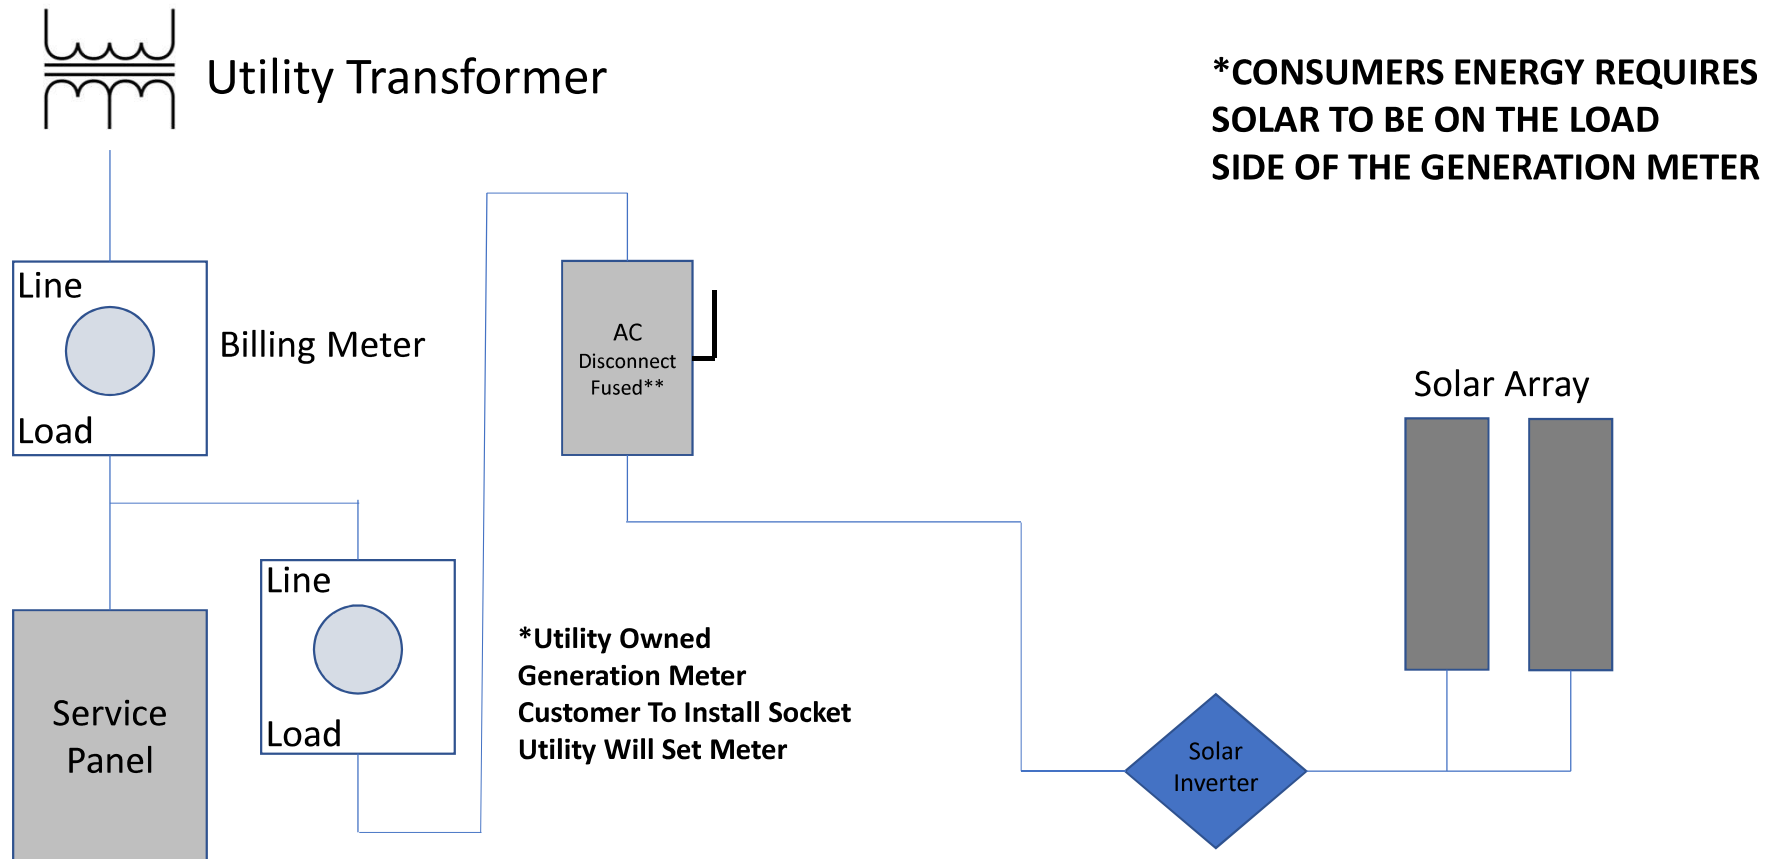

\*\*Consumers Energy will also accept a non-fused AC disconnect if it is system is tied into a breaker in the service panel. AC disconnect to be located within 5' of meters.